

प्लास्टिक्स परीक्षण केन्द्र
PLASTICS TESTING CENTRE
परीक्षण रिपोर्ट
TEST REPORT

क्र. सं. / SI. No.

6627



Issued to :
The Head-Business Development
M/s. Ashima Paper Products
IMT Manesar
Haryana – 122050.

Test Report No : 19167
Date : 27.07.2019

Page 1 of 2

Ref No: Letter dt. 27.06.2019 & 02.07.2019

PART A : PARTICULARS OF SAMPLE SUBMITTED

Nature of Sample	: Paper Cup (water based coated) sample as stated by party
Grade / Variety / type / Size / Class etc.	: Nil
Brand name, if any	: Nil
Declared values, if any	: Nil
Code No.	: Nil
Batch No. and date of manufacture	: Nil
Quantity	: 800 Nos.
Mode of Packing	: Packed in carton
Date of receipt of sample	: 12.07.2019
Date of commencement of test	: 19.07.2019
Date of completion of test	: 26.07.2019
Sealed or not	: Not Sealed
Any other information	: Nil

PART B: SUPPLEMENTARY INFORMATION

- Reference to sampling procedure : Supplied by the party
- Supporting documents for the measurements : Nil
taken and results derived like graphs, tables,
sketches and / or photographs as appropriate
to test report, if any (to be attached)
- Deviation from the test methods as : Nil
prescribed in relevant ISS / Work
instructions, if any



प्लास्टिक्स परीक्षण केन्द्र
PLASTICS TESTING CENTRE
परीक्षण रिपोर्ट
TEST REPORT

क्र. सं. / SI. No. 6627



Test Report No : 19167

Date : 27.07.2019

Page 2 of 2

PART C : TEST RESULTS

Sl. No.	Name of the Test	Test Method	Unit	Results obtained
1.	Material identification	FTIR Analysis & DSC Analysis	--	Cellulose

Comments: The sample has a fine coating (may be Acrylic based). The sample does not contain Polyethylene, Polypropylene, Polyvinyl Chloride, Polystyrene or Polyethylene Terephthalate.

PART D : REMARKS



- NB: i) The results stated above related only to the items tested.
ii) This Test Certificate shall not be reproduced except in full without the written approval.
iii) Details of test subcontracted – Nil.


QUALITY MANAGER
AUTHORIZED SIGNATORY


Sample: TC 190703 Coating2
Size: 7.2000 mg
Method: Custom

DSC

File: C:\...TC 190703 Coating2.001
Operator: TA
Instrument: DSC Q20 V24.11 Build 124

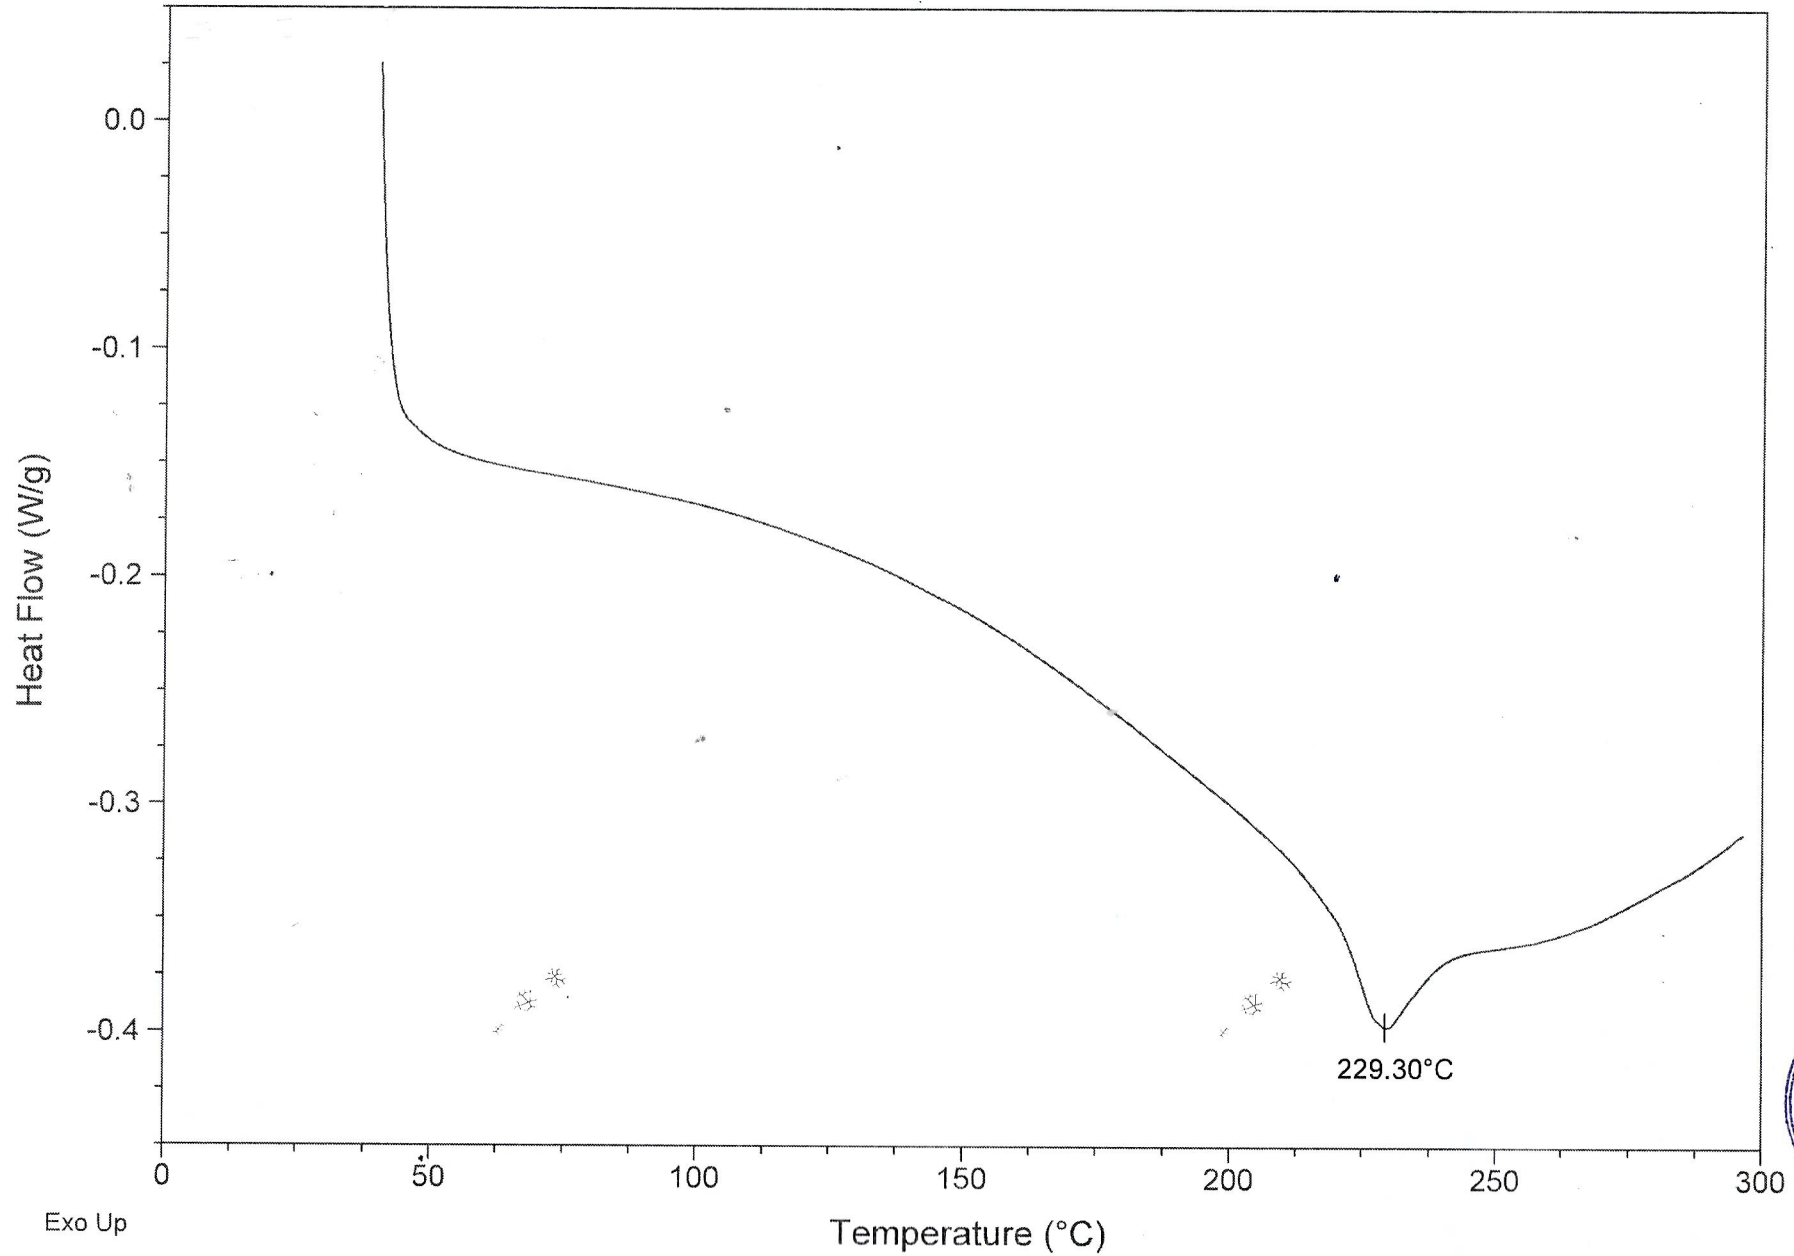

Analyst CIPET:IPT- KOCHI
Date 26 July 2019 11:03

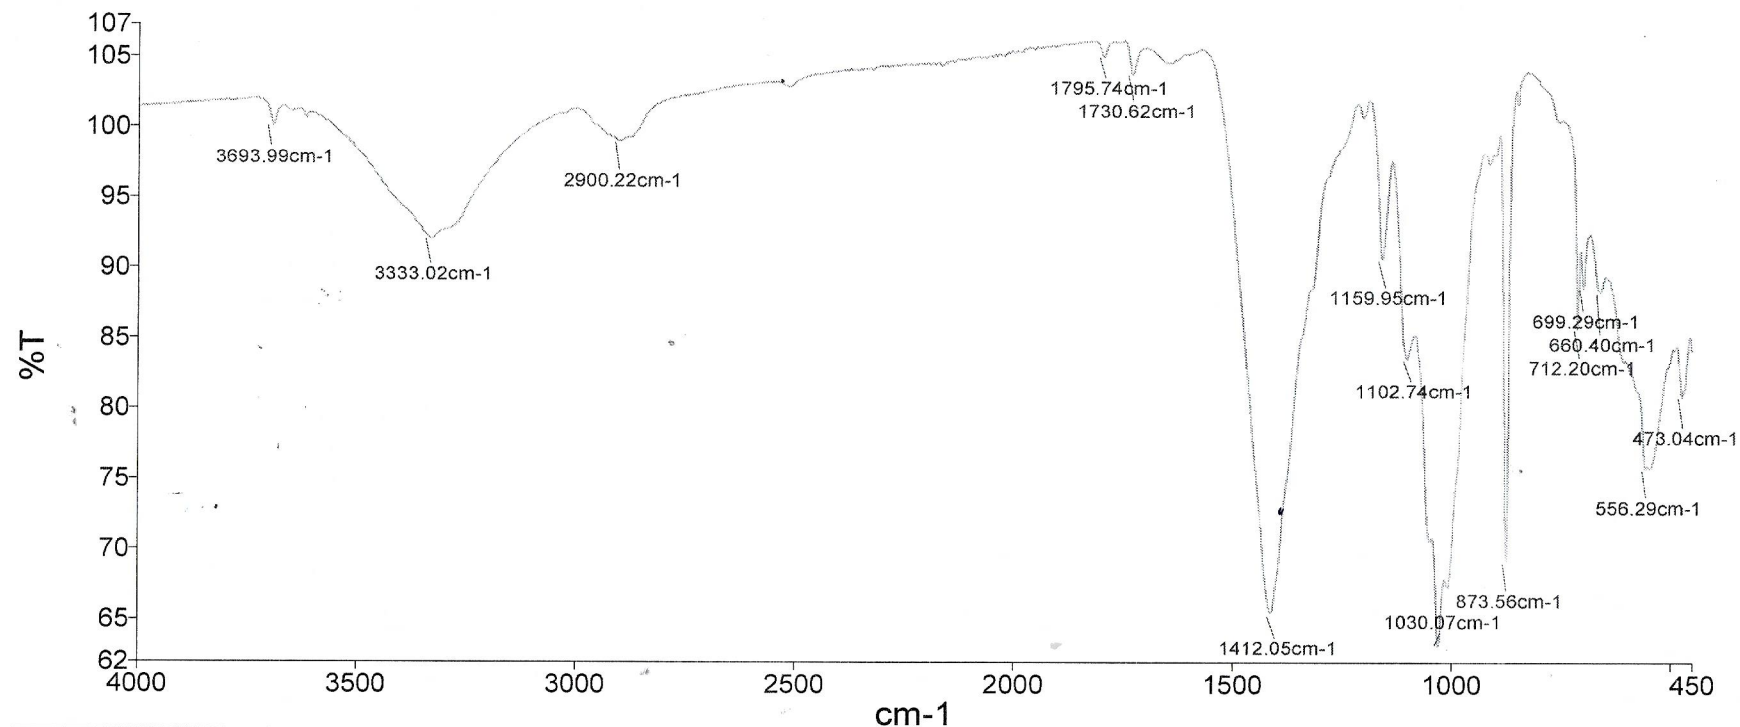


Sample Name	Description	Quality Checks	Search Score	Search Best Hit
TC 190703	Monday, July 15 2019	The Quality Checks do not report any warnings for the sample.	0.686951	AR0102
Search Best Hit Description				
CELLULOSE				



Analyst
Date

CIPET:IPT- KOCHI
26 July 2019 11:01

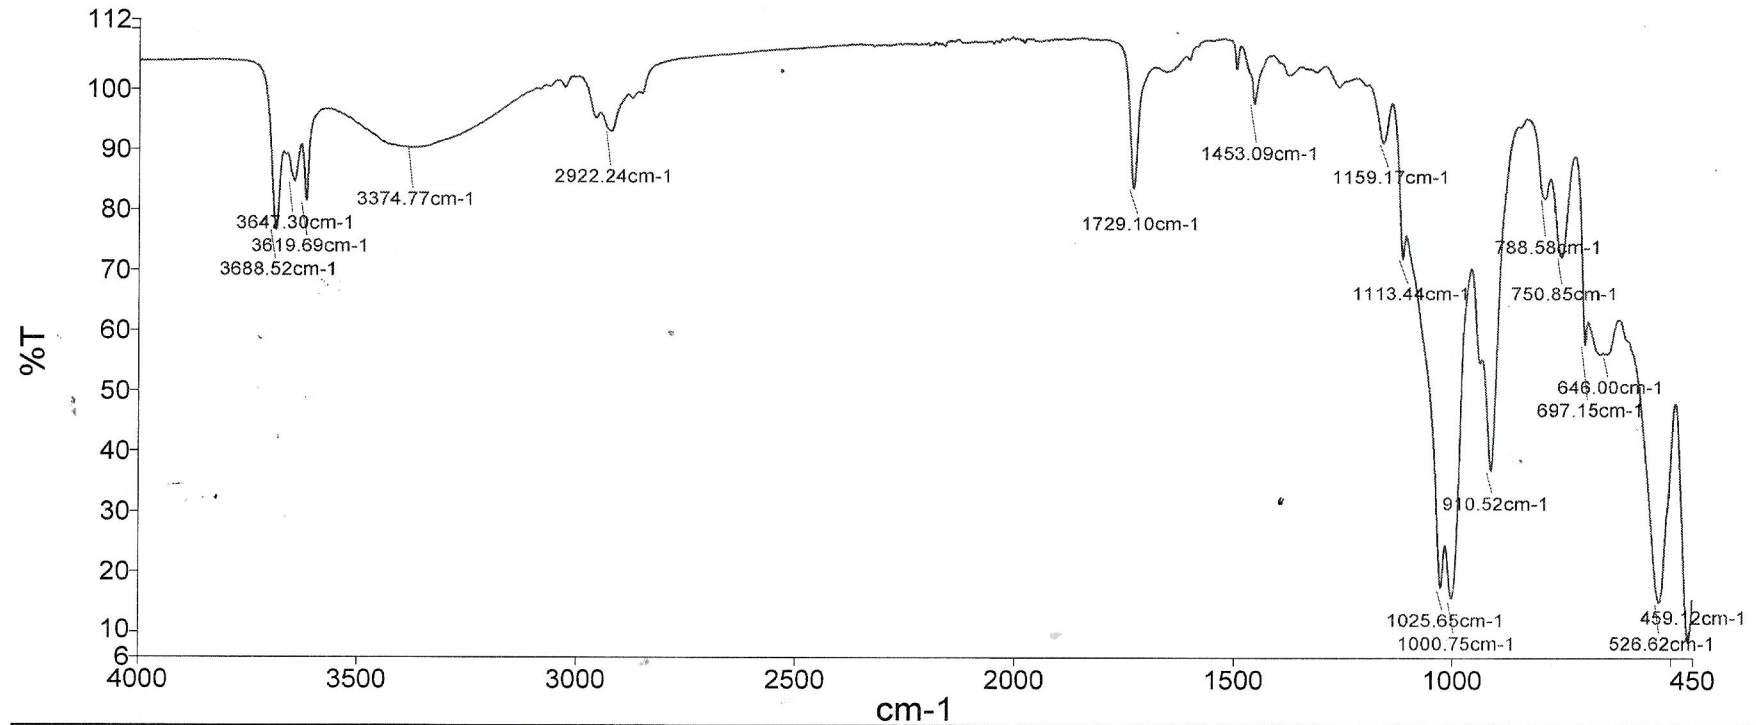

Sample Name	Description	Quality Checks
TC 190703 (Coating)	Friday, July 26 2019	The Quality Checks do not report any warnings for the sample.

